

LIGHTING FIXTURE SCHEDULE						
TYPE	BASE MANUFACTURER	NO. OF LAMPS	LAMP TYPE	VOLTS	MOUNTING	DESCRIPTION
'P'	LUMINAIRE - SPRING CITY #WA11-175-MH-REF-120-III-BK-CARMEL BLACK. POLE - VALMONT #FL210-7.5-12F-GP/FP-AB-CARMEL BLACK BASE - SPRING CITY #WA-18-7.5-SLIP-CARMEL BLACK	1	175 WATT METAL HALIDE	120		15 FT. FLUTED STEEL POLE, 7.5" AT BOTTOM WITH HANDHOLE 12" ABOVE BASE. 18" SLIP FIT BASE TO FIT 7.5" POLE AT 7.46". PAINTED BLACK. REFRACTIVE POLYCARBONATE GLOBE WITH FINIAL.

1. SEE SPECIFICATIONS FOR BALLAST MANUFACTURERS.

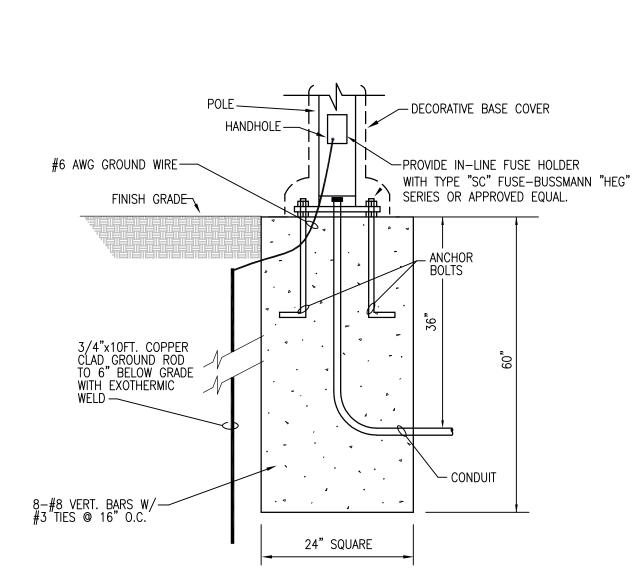


LIGHT POLE BASE FOR TYPE 'P' SCALE: NONE

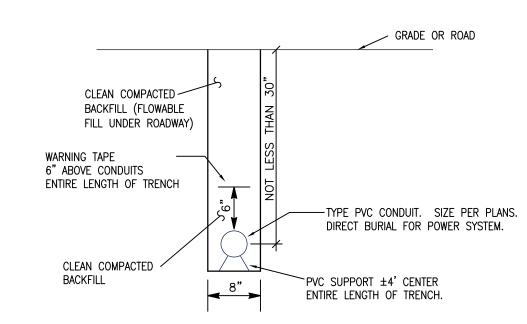

NOTES:

1. SEE SPECIFICATION SECTION 02200 FOR EXCAVATION, BACKFILL, BEDDING MATERIALS.

ELECTRICAL CONDUIT BURIAL DETAIL

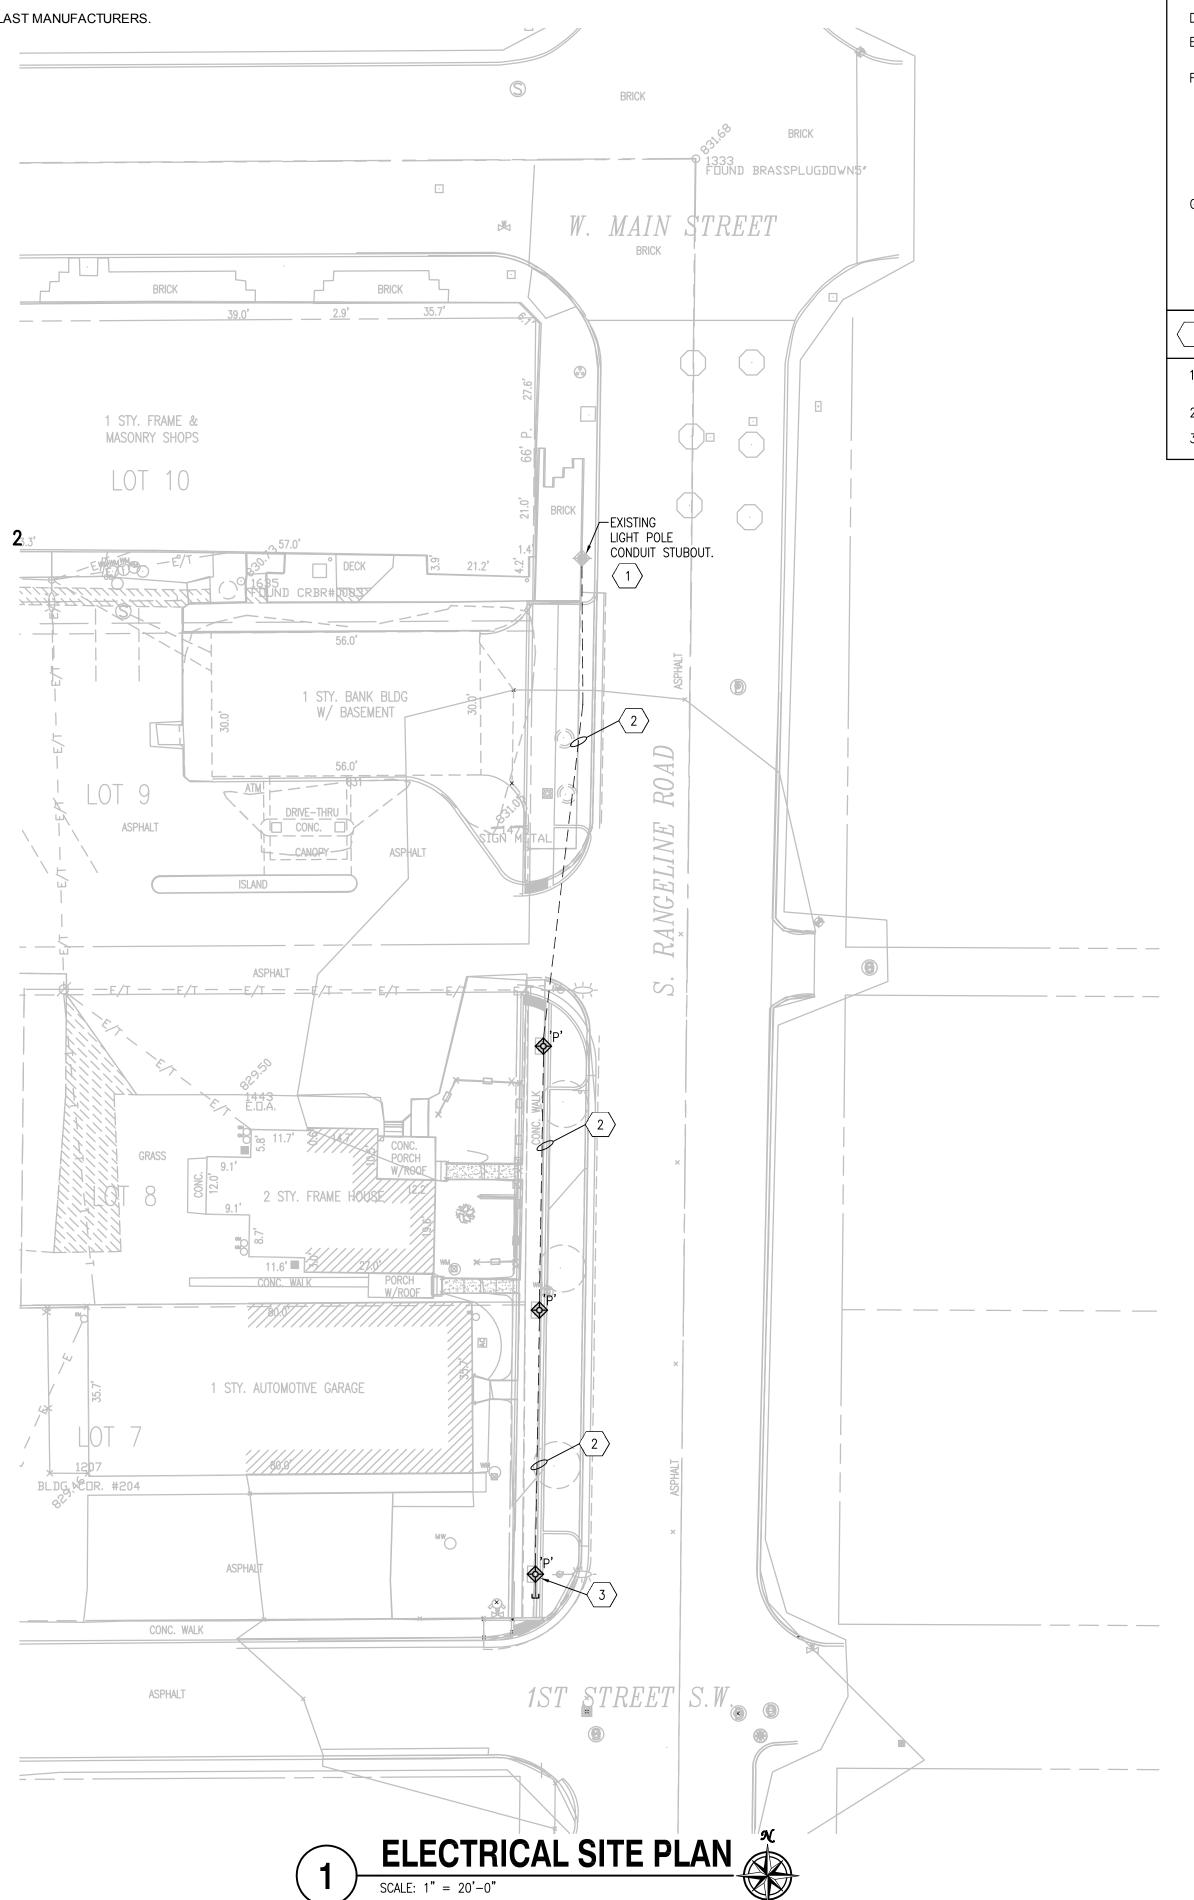

GENERAL NOTES

- A. DRAWINGS ARE DIAGRAMMATIC. ALL DIMENSIONS SHOWN ARE APPROXIMATE. ALL LOCATIONS SHALL BE FIELD VERIFIED.
- B. ALL WORK SHALL BE IN CONFORMANCE WITH THE NATIONAL ELECTRICAL CODE LATEST EDITION ADOPTED BY INDIANA, THE INDIANA ELECTRICAL CODE AMMENDMENTS, LOCAL/MUNICIPAL CODES, AND THE AUTHORITY HAVING JURISDICTION.
- C. ALL CONDUIT PENETRATIONS SHALL BE SEALED WITH APPROPRIATE CONDUIT SEALING MATERIAL.
- D. ALL CABLE SIZES SHALL UTILIZE COPPER CONDUCTORS.
- E. EACH SINGLE PHASE BRANCH CIRCUIT CONDUCTOR SHALL HAVE A DEDICATED NEUTRAL BACK TO THE PANELBOARD.
- F. THE CONTRACTOR IS RESPONSIBLE FOR ALL UNDERGROUND CONDUIT ROUTING. ALL UNDERGROUND ROUTING SHALL BE IN CITY OF CARMEL PROPERTY OR UTILITY EASEMENT WHERE ALLOWED BY CINERGY. UNDERGROUND ROUTING SHOWN ON THIS DRAWING IS DIAGRAMMATIC ONLY AND NOT TO BE USED FOR LOCATION PURPOSES. ANY UNDERGROUND ROUTING NOT REVIEWED AND APPROVED BY CINERGY AND THE CITY OF CARMEL SHALL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR. ANY CORRECTIONS TO LOCATIONS OF UNDERGROUND ROUTING SHALL BE BORNE BY THE CONTRACTOR.
- G. THE CONTRACTOR SHALL BE RESPONSIBLE FOR FIELD VERIFYING THE EXACT LOCATIONS OF ALL LIGHT POLE BASES AND COORDINATION WITH OTHER WORK. THE CONTRACTOR IS RESPONSIBLE FOR PLACEMENT OF LIGHT POLE BASES IN RELATION TO THE FINAL STREETSCAPE PAVER PLAN. THE CONTRACTOR SHALL OBTAIN APPROVAL OF THE CIVIL ENGINEER AND MAKE ANY ADJUSTMENTS OR RELOCATIONS OF LIGHT POLE BASES REQUIRED TO FIT PROPERLY IN THE FINAL STREETSCAPE PAVER PLAN PRIOR TO CASTING

SHEET KEYNOTES

- 1. EXTEND EXISTING 1" PVC FOR LIGHTING CIRCUIT. EXTEND EXISTING 1" PVC WITH NYLON PULL CORD FOR FUTURE USE BY THE CITY OF CARMEL.
- 2. 2#8, #10G., 1" C. LIGHTING CIRCUIT. 1" PVC WITH NYLON PULL CORD FOR FUTURE.
- 3. STUB OUT (2) 1" PVC FOR FUTURE.

SYMBOLS:



LIGHT POLE WITH SQUARE BASE. VERIFY ORIENTATION OF BASE IN RELATION TO STREETSCAPE WORK

--- underground conduit



Carmel Redevelopment Commission 30 West Main Street, Suite 220 Carmel, Indiana 46032 317.571-2787 (ARTS)

CSO Architects ARCHITECTURE • INTERIOR DESIGN

280 East 96th Street, Suite 100 $\,\cdot\,\,$ Indianapolis, Indiana 46240 Main 317.848.7800 · Fax 317.574.0957 · csoinc.net

CONSULTING ENGINEERS

280 EAST 96TH STREET, SUITE 280 INDIANAPOLIS, IN 46240 317.706.2075 WWW.LACEINDY.COM

PARCEL 93 STREETSCAPE SOUTH RANGE LINE ROAD


100 SOUTH RANGE LINE ROAD CARMEL, IN. 46032

Scope Drawings: These drawings indicate the general scope of the project in terms of architectural design concept, the dimensions of the building, the major architectural elements and the type of structural, mechanical and electrical systems. The drawings do not necessarily indicate or describe a work required for full performance and completion of the requirements of the Contract. On the basis of the general scope indicated or described, the trade contractors shall furnish all items required for the proper execution and completion of the work.

Drawing Title:

ELECTRICAL SITE PLAN

05/18/09



Drawing Number: E100

L'Acquis Project Number:

09064

HOLEY MOLEY SAYS,
"DON'T
DIG
BLIND" 1-800-382-5544 CALL TOLL FREE
1-800-428-5200
FOR CALLS OUTSIDE OF INDIA